



中国国家强制性产品认证证书

证书编号：2018010307051546

委托人名称、地址

国郁企业股份有限公司
台湾云林县斗六市科加六路17号

生产者（制造商）名称、地址

东莞国显电子有限公司
广东省东莞市黄江镇田美村东环路4号

生产企业名称、地址

东莞国显电子有限公司
广东省东莞市黄江镇田美村东环路4号

产品名称和系列、规格、型号

设备用断路器
94□-□-□□□□; 详见参数附件

产品标准和技术要求

GB/T17701-2008


上述产品符合强制性产品认证实施规则 CNCA-C03-02:2014 的要求，
特发此证。

发证日期：2019年07月25日 有效期至：2023年03月06日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。


本证书为变更证书，证书首次颁发日期：2018年03月06日

本证书的相关信息可通过国家认监委网站 www.cnca.gov.cn 查询



主任：

陆楠

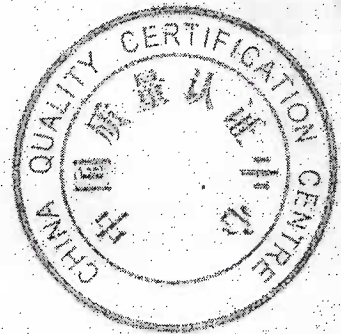

中国质量认证中心



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO.: 2018010307051546

NAME AND ADDRESS OF THE APPLICANT

KUOYUH W.L. ENTERPRISE CO.,LTD.
No.17 Kejia 6th Road, Douliu City, YunLin, Taiwan, P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

KUOYUH (DONGGUAN) ENTERPRISE CO.,LTD.
No.4,Donghuan Road,Tianmei Village,Huangjiang Town,Dongguan City,Guangdong Province,
P.R.China

NAME AND ADDRESS OF THE FACTORY

KUOYUH (DONGGUAN) ENTERPRISE CO.,LTD.
No.4,Donghuan Road,Tianmei Village,Huangjiang Town,Dongguan City,Guangdong Province,
P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION

Circuit-breakers for Equipment
94□-□-□□□□; See the Appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T17701-2008

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO.CNCA-C03-02:2014).


Valid from: Jul.25,2019

Valid until: Mar.06,2023

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.


Date of original issued: Mar.06,2018

The certificate information is available through CNCA's website: www.cnca.gov.cn



President:

Lu Mei

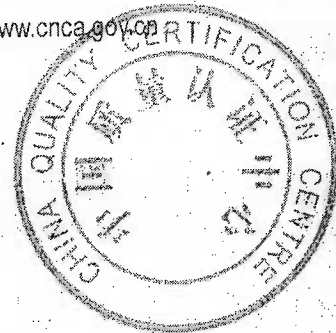

CHINA QUALITY CERTIFICATION CENTRE



中国国家强制性产品认证证书

变更结论 Modification Approval

证书编号 Certificate No. : 2018010307051546

申请编号 Application No. : A2019CCC0307-3172713

申请人(委托人) Applicant: 国都企业股份有限公司 / KUOYUH W.L. ENTERPRISE CO.,LTD.

证书编号 Certificate No.(变更前 Original): 2018010307051546

变更产品名称: 设备用断路器

Name of Product Modified: Circuit-breakers for Equipment

变更情况 Situation of Modification (见下表 See table below) :

序号	项目 Item	变更前 Original	变更后 Present
1	额定限制短路电流 (Incl) 参数变更	500A	1000A
2	额定电流下的性能参数变更	试验次数: 3000 次	试验次数: 10000 次

现批准以上变更。

Above Modification is approved. The present will replace the original.


批准日期 (Date) : 2019 年 07 月 25 日

第 1 页 / 共 1 页



主任:

陆杨

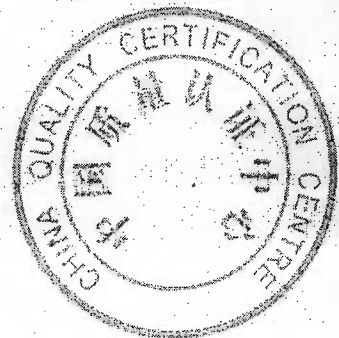

中国质量认证中心



中国国家强制性产品认证证书

附 录

第 1 页 共 2 页

证书编号: 2018010307051546

纸 号: 2388285

94□-□-□□□□;

Ue: AC125/250V;


In: 4.0A, 4.25A, 4.5A, 4.75A, 5.0A, 5.25A, 5.5A, 5.75A, 6.0A,
6.25A, 6.5A, 6.75A, 7.0A, 7.25A, 7.5A, 7.75A, 8.0A, 8.25A,
8.5A, 8.75A, 9.0A, 9.25A, 9.5A, 9.75A, 10.0A, 10.25A, 10.5A,
10.75A, 11.0A, 11.25A, 11.5A, 11.75A, 12.0A, 12.25A, 12.5A,
12.75A, 13.0A, 13.25A, 13.5A, 13.75A, 14.0A, 14.25A, 14.5A,
14.75A, 15.0A, 15.25A, 15.5A, 15.75A, 16.0A;

额定限制短路电流 PCI(Incl): 1000A;


操作方式: S 型;

1P

注: 此附录与证书同时使用时有效。



主 任: 陆 楠

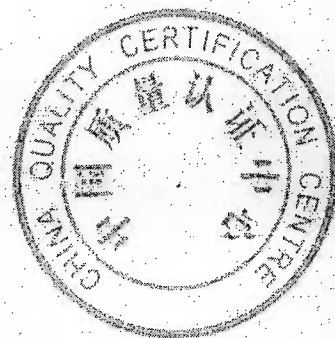

中国质量认证中心



中国国家强制性产品认证证书

附 录

第 2 页 共 2 页

证书编号: 2018010307051546'

纸 号: 2388285

型号的解释:

94□ - □ - □ □ □ □

① ② ③ ④ ⑤ ⑥

①: 表示产品型号如: 94N 表示 94N 系列, 94D 表示 94D 系列;

②: 表示产品额定电流规格: 4A-16A

如 5A, 表示额定工作电流为 5 安培;


③: 表示按钮类型: A: 圆弧按钮, B: 直面按钮;

④: 表示端子类型: 1: 5.5mm 长端子, 2: 9.5mm 长端子;

⑤: 表示本体颜色类型: B: 黑色、W: 白色、G: 灰色;


⑥: 表示按钮颜色类型: R: 红色、B: 黑色。

注: 此附录与证书同时使用时有效。



主 任:

陆 楠

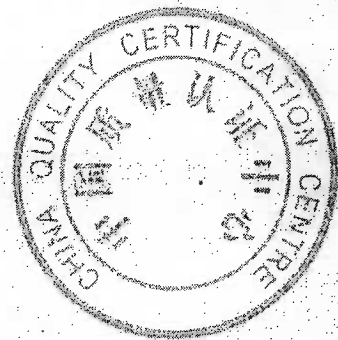

中国质量认证中心